Three-phase Meter Quick Guide



Overview


DTSU666 series three phase four wire electronic energy meter(din-rail) is designed based on power monitoring and energy metering demands for electric power system, communication industry, construction industry, etc. as a new generation of intelligent instrument combining measurement and communication function, mainly applied into the measurement and display for the electric parameters in the electric circuit including three voltage, three current, active power, reactive power, frequency, positive energy, four-quadrant energy, etc. Adopting the standard DIN35mm din rail mounting and modular design, it is characterized with small volume, easy installation and easy networking, Can be applied into Growatt Hybrid inverter and AC coupled inverter.

2. Technical Parameters

General Specifications		
Rated voltage	3×230/400Vac	
Reference frequency	50Hz/60Hz	
Specified operating voltage range	0.9Un~1.1Un	
Extended operating voltage range	0.8Un~1.15Un	
Voltage line power consumption	≤1.5W/6VA	
Input current	0.25-5(80)A	
Starting current	0.004lb	
AC voltage withstand	2KV /5mA for 1 minute	
Impulse voltage withstand	4KV-1.2/50uS wavform	
Max. Reading	999999kWh	
Accuracy		
Active power	1% of range maximum	
Reactive power	2% of range maximum	


Enviroment		
Rated temperature	-10℃~+45℃	
Limit temperature	-25℃~+70℃	
Relative humidity(average annual)	<75%	
Atmosphere	63.0kPa~106.0kPa	
Installation category	CAT III	
Degree of pollution	Conform to RoHS	
Communication		
Communication	RS485 output for Modbus RTU	
Baud rate	9600	
Pulse	400imp/kWh	
Mechanics		
Din rail dimensions	100x72x65(LxWxH)	
Mounting	DIN rail 35mm	
Sealing	IP51 (indoor)	


3. Unpacking

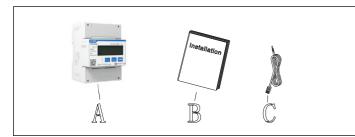


Item	Number	Description
Α	1	Three phase meter
В	1	Rs485 cable (standard length 5m)
С	1	User Manual

4. Dimension (Unit: mm)

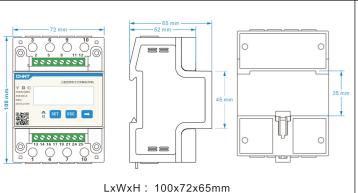

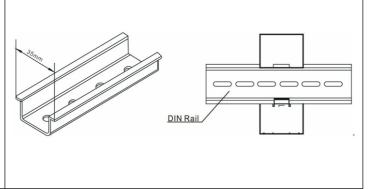


5. Installation





Communication and pulse output terminal




LAN line 1-8 colors as below:

PIN	1	2	3	4
Clour	White orange	Orange	White green	Blue
PIN	5	6	7	8
Clour	White	Green	White brown	Brown


Note: We describe Growatt hybrid inverter as "SPH" as below.

- a. When SPH series products are used in three-phase power grid, system, please set the "Sensor:Cable CT" of SPH as "Sensor: Meter". More details, please refer to SPH user manual.
- b. For example, when connecting three-phase energy meter, SPH gets the information of the sum of three-phase active power to process the logical control by RS485 communication. The following figure is a diagram of the SPH working system.

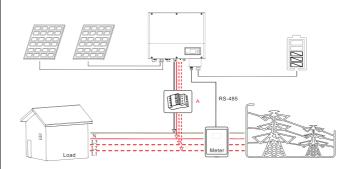



Note: As shown in the figure above, a switch must be installed at point A.In the process of use, if the SPH needs to be turned off, please turn off the switch at point A.


c. Install the three-phsae energy meter in inlet AC distribution cabinet, and connect it to utility grid(L1, L2, L3) according to responding indicator mark. The arrow on the meter indicates the grid access port.

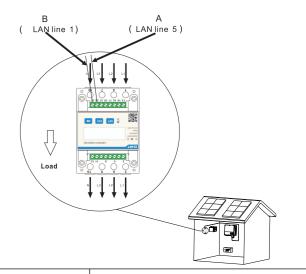


d. Connect the A+ (White-Blue)of Rs485 cable to Pin24 and B- (White-Orange)







f. The standard RS485 cable length is 5m. If the length is not long enough, plaease add another cable to extend the length.



- 1. Be careful the wire of input and output of L/N and the range of input voltage or current, if the data is outrange, it may destroy the meter.
- 2. Be careful the input and output of meter line, if lines are wrong, system will work in a wrong way.

Note: If there is no communication (SPH shows warning 401 or meter communication indicator is don't display), please check the communication on LAN line, baud rate, and address.

6. Display

From the displayed interface, the electrical parameter and energy data are all primary side data (that is, the multiplied by current and voltage ratios). The energy measuring value will be displayed seven bits, with the displaying range from 0.00kWh to 9999999Mwh.





NO	Display interface	Instruction	NO	Display interface	Instruction
1	Inp. W h	Positive active energy =10000.00kWh	10	16 5.002	Phase C current =5.002A
2	234557 ^k W h	Reserve active energy =2345.67kWh	11	PL 3291*	Combined phase active power =3.291kW
3	n 1-9.500	Communication protocol is ModBus-RTU. N1 indicates that there are 1 stop bits without parity.	12	PA (090 *	Phase A active power =1.090kW
4	<u> </u>	9.600 indicates that the baud rate is 9600bps 001 indicating table address	13	Pb (101 *	Phase B active power =1.101kW
5	NU 5500	Phase A voltage =220.0V	14	PE 1.100 k	Phase C active power =1.100kW
6	[17 550 lv]	Phase B voltage =220.1V	15	FŁ 0.500	Combined phase power factor PFt=0.500L
7	NE 550'5^	Phase C voltage =220.2V	16	FR 1.000	Phase A power factor Pfa =1.000L
8	I A 5.000 A	Phase A current =5.000A	17	Fb 0.500	Phase B power factor Pfb =0.500L
9	16 5001	Phase B current =5.001A	18	FC-0.500	Phase C power factor Pfc = -0.500L

Note: This meter and SPH default communication address is 04, the baud rate is 9600, if the meter and SPH communication is not on, you can confirm the communication address and baud rate is accurate, view and modify the path as follows:

Button description: "SET" button represents "confirmation", or "cursor shift" (when input digits), "ESC" button represents "exit", "

"" ()
button represents "add". The input code is (default 701).

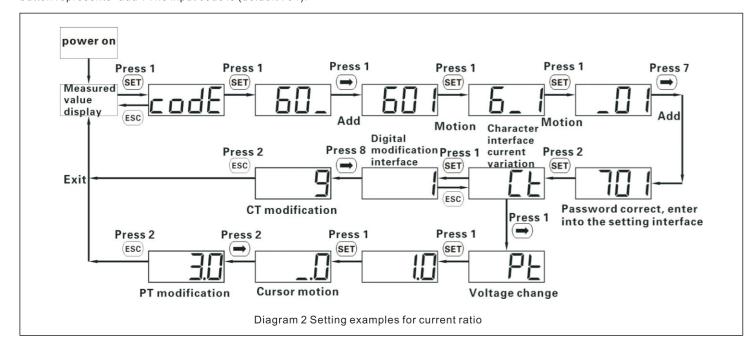

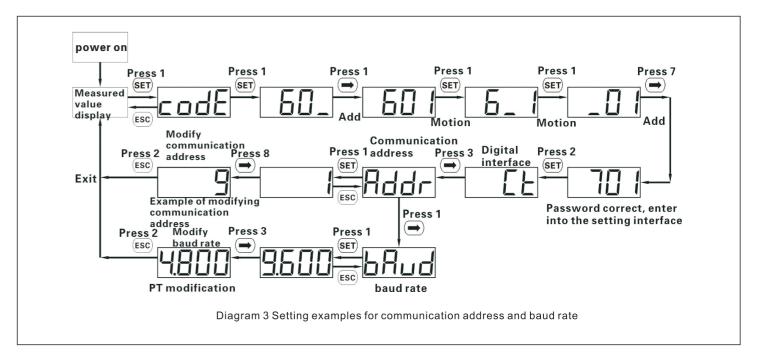

7. Trouble shooting

Fault phenomenon	Reason analysis	Elimination	
Big deviation between electric energy measurement and actual value.	If it is wrongly connected, please reconnect based on the right wiring mode (see the wiring diagram). If not the above problems, please contact with the local supplier.	Wiring error, voltage and current corresponding phase sequence is correct? If the ends of the incoming and downstream ends of the current transformers reversed?	
The downstream power data and the upstream power data are not displayed in the SPH.	The downstream power data and the upstream power data are not displayed in the SPH.	1.Check the "CT mode" of SPH is "energy meter mode". 2.Check the voltage between A+ and B- is within the range of +(4.4~4.5)V; 3.Check the RS485 communication cable is right. That is to say the A+/B+ of energy meter is matched to A+/B- of SPH. Also,make sure the wiring is fixed firmly.	







Growatt New Energy



Download Manual

Shenzhen Growatt New Energy Technology CO.,LTD No.28 Guangming Road, Shiyan Street, Bao'an District, Shenzhen, P.R.China

T +86 0755 2747 1942

E service@ginverter.com

w www.ginverter.com

GR-UM-170-A-01